


NAMI NOTICE OF PRODUCT LINE CERTIFICATION

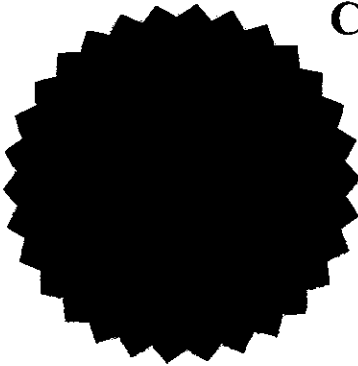

Certification No.: NI006740 Page 1
Date: 10/02/2006
Revision Date: _____
Certification Program: Structural
Company: Jeld-Wen
Code: J-104-3

The "Notice of Product Line Certification" is valid only when Administrator's Seal is applied to the upper left hand portion of this form and a certification label is applied to the product. This certification seal represents product conformity to the applicable specification and that all certification criteria has been satisfied.

The products and systems listed below are approved for listing in the Directory of Certified Products at www.NAMICertification.com. Please review, and advise NAMI immediately if data, as shown requires corrections.

Company: Jeld-Wen Exterior Doors
3737 Lakeport Boulevard
Klamath Falls, OR 97601

Product Line: Premium Fiberglass Lip-Lite Glazed Impact Doors and Non-Impact Side-lites

Test Report: ATI-65888.02-301-44

Section 1: General Description of the Products and Systems under this Certification

- 1.1 **Frame:** The frame jambs consist of finger jointed pine with all corners coped and butted. The head was attached to the jambs with three (3) 16 ga 7/16" crown x 2" long staples on each side. The sill was attached to the jambs with three (3) 16 ga 7/16" crown x 2" long staples on each side.
- 1.2 **Door Panel Construction:** Each fiberglass door panel was constructed from two (2) 0.065" thick fiberglass skins separated by wood rails and stiles.
- 1.3 **Side-Lite Leaf Construction:** Leaf construction is the same as the door panel, except latch stile is dimensioned the same as the hinge stile.
- 1.4 **Panel Glazing:** The overall insulated glass unit was comprised of one (1) 1/8" thick tempered glass lite, a 1/2" air space, and a laminate with one (1) 1/8" annealed glass, a 0.090" PVB interlayer by Solutia, and a 1/8" annealed glass.
- 1.5 **Side-Lite Glazing:** The overall insulated glass unit was comprised of two (2) 1/8" thick tempered glass lites with a 1/4" air space.

National Accreditation & Management Institute, Inc.
11870 Merchants Walk Suite 202-Newport News, VA 23606
TEL(757) 594.8658 FAX(757)594-8659

Section 2: Registered Suppliers

2.1	Door Lites:	ODL
2.2	Astragal:	Endura
2.3	Sills	Endura (FOB4566A)

See additional Pages of Certification for Certified Product Line Matrix(s) and Installation Details. If you have any questions regarding this certification, please contact NAMI at (757)594-8658.

National Accreditation & Management Institute, Inc.
11870 Merchants Walk Suite 202-Newport News, VA 23606
TEL(757) 594.8658 FAX(757)594-8659

NOTICE OF PRODUCT CERTIFICATION

Company: Jeld-Wen Exterior Doors
3737 Lakeport Boulevard
Klamath Falls, OR 97601

Certification No.: NI006740 Page 3
Certification Date: 10/02/2006
Expiration Date: 07/31/2010

Product: Premium Fiberglass Lip-Lite Glazed Impact Outswing Doors and w/ and w/o Non-Impact Rated Sidelites (w/Wood Frame unless noted)

**Specifications Tested To: ASTM E283-91/E330-02/E331-00/E2068-00/E1304-02/E1886-05/E1996-05
Glass Complies to ASTM E1300-02**

The "Notice of Product Certification" is only valid if the NAMI Certification Label has been applied to the product as described within this document. The certification label represents product conformity to the applicable specification and that all certification criteria has been satisfied. This product has been approved for listing within NAMI's Certified Product Listing at www.Namicertification.com. NAMI's Certification Program is accredited by The American National Standards Institute (ANSI).

Configuration	Inswing or Outswing	Glazed or Opaque	Maximum Size	Design Pressure Pos/Neg	Missile Impact Rated	Test Report Number Drawing Number & Comments
X Single	O/S	Glazed	3'2" x 8'2"	+60/-60	Yes	ATI-65888.02-301-44 Max Panel Size: 3'0" x 8'0" Opening: 1'11" x 6'7"
XX Double	O/S	Glazed	6'3" x 8'2"	+60/-60	Yes	ATI-65888.02-301-44 Max Panel Size: 3'0" x 8'0" Opening: 1'11" x 6'7"
XO/OX Single w/Sidelites	O/S	Glazed Door Glazed Sidelite	4'6" x 8'2"	+60/-60	Door-Yes Sidelite-No	ATI-65888.02-301-44 Max Panel Size: 3'0" x 8'0" Opening: 1'11" x 6'7"
OXO Single w/Sidelites	O/S	Glazed Door Glazed Sidelites	5'9" x 8'2"	+60/-60	Door-Yes Sidelites-No	ATI-65888.02-301-44 Max Panel Size: 3'0" x 8'0" Opening: 1'11" x 6'7"
OXXO Double w/Sidelites	O/S	Glazed Doors Glazed Sidelites	8'10" x 8'2"	+60/-60	Doors-Yes Sidelites-No	ATI-65888.02-301-44 Max Panel Size: 3'0" x 8'0" Opening: 1'11" x 6'7"

**National Accreditation & Management Institute, Inc./11870 Merchants Walk Suite 202/Newport News, VA 23606
Tel-757.594.8658/Fax-757.594.8659**

NAMI AUTHORIZED SIGNATURE: _____

